


- Sketch to Show Intent -
 Condensate Neutralization Drain
 From Aero Boiler (heating or domestic water)

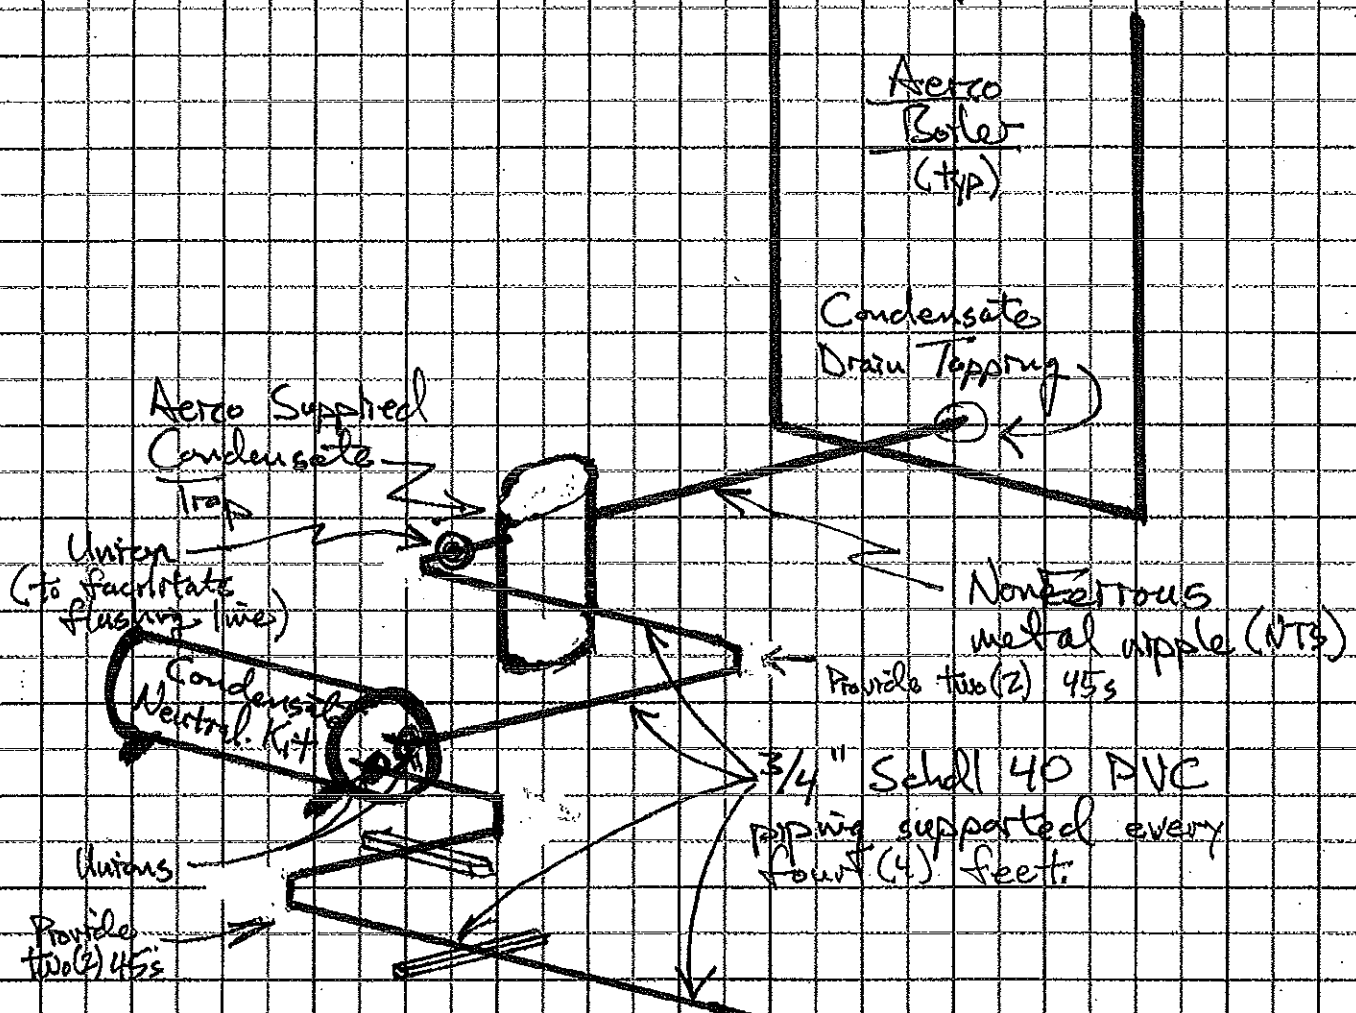

- All Sch 40 PVC piping to be run at $\frac{1}{4}$ " per foot slope to appropriate FD/FS with air gap.

- Cond. Neut. Kit to be sized by Manufacture / Engineer.

- Drain piping to be run shortest route possible and not pose hazard to walkways.

Not to Scale
 T. Severance
 3-24-14

